

# Temperaturverlauf Verdichterzyklus 30.12.2023

(Außentemperatur: 8,9 °C)

	18.23	18.25	18.30	18.35	18.40	18.45	18.50	18.55	19.00	19.05	19.10	19.15	19.18	19.20
Vorlauftemperatur Sekundärkreis (°C)		37,2	42,0	44,9	46,6	48,4	49,8	50,5	51,4	52,3	53,2	54,0		31,3
Temperatur Pufferspeicher (oben) (°C)	Verdichter an	29,6	29,6	29,7	29,7	29,9	30,0	30,1	30,1	30,2	30,3	30,4	Verdichter aus	31,8
Vorlauftemperatur Radiatoren-Hzg. (°C)		37,3	42,0	45,2	46,4	48,6	49,6	50,6	51,6	52,6	53,6	53,6		31,6
Temperatur Warmwasser (°C)		43,0	40,7	41,9	44,1	45,1	46,1	48,1	49,1	49,1	50,1	51,1		52,1
Temperatur Speicher Warmwasser (°C)		43,0	40,7	41,9	44,1	45,1	46,1	48,1	49,1	49,1	50,1	51,1		52,1

Bilder 18:32 Uhr

Bilder 18:47 Uhr

Bilder 19:02 Uhr

Bilder 19:13 Uhr

Bilder 19:22 Uhr


Vorlauftemperatur  
FB-Heizung immer  
< 30 °C

Keine besondere  
Wasserentnahme  
oder Hzg-  
Anforderung


Bilder 18.32 Uhr




Bilder 18.47 Uhr

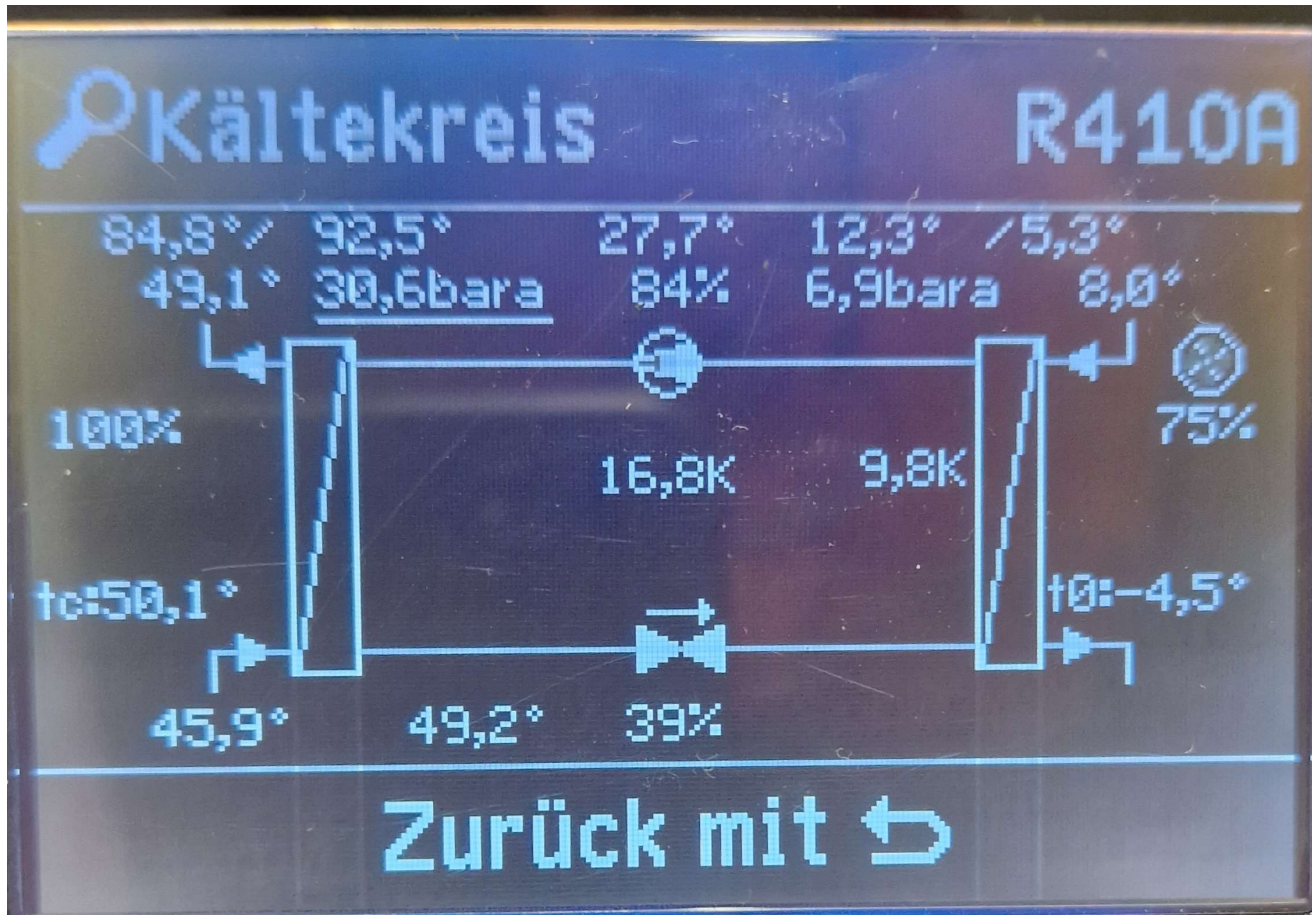

Bilder 19.02 Uhr

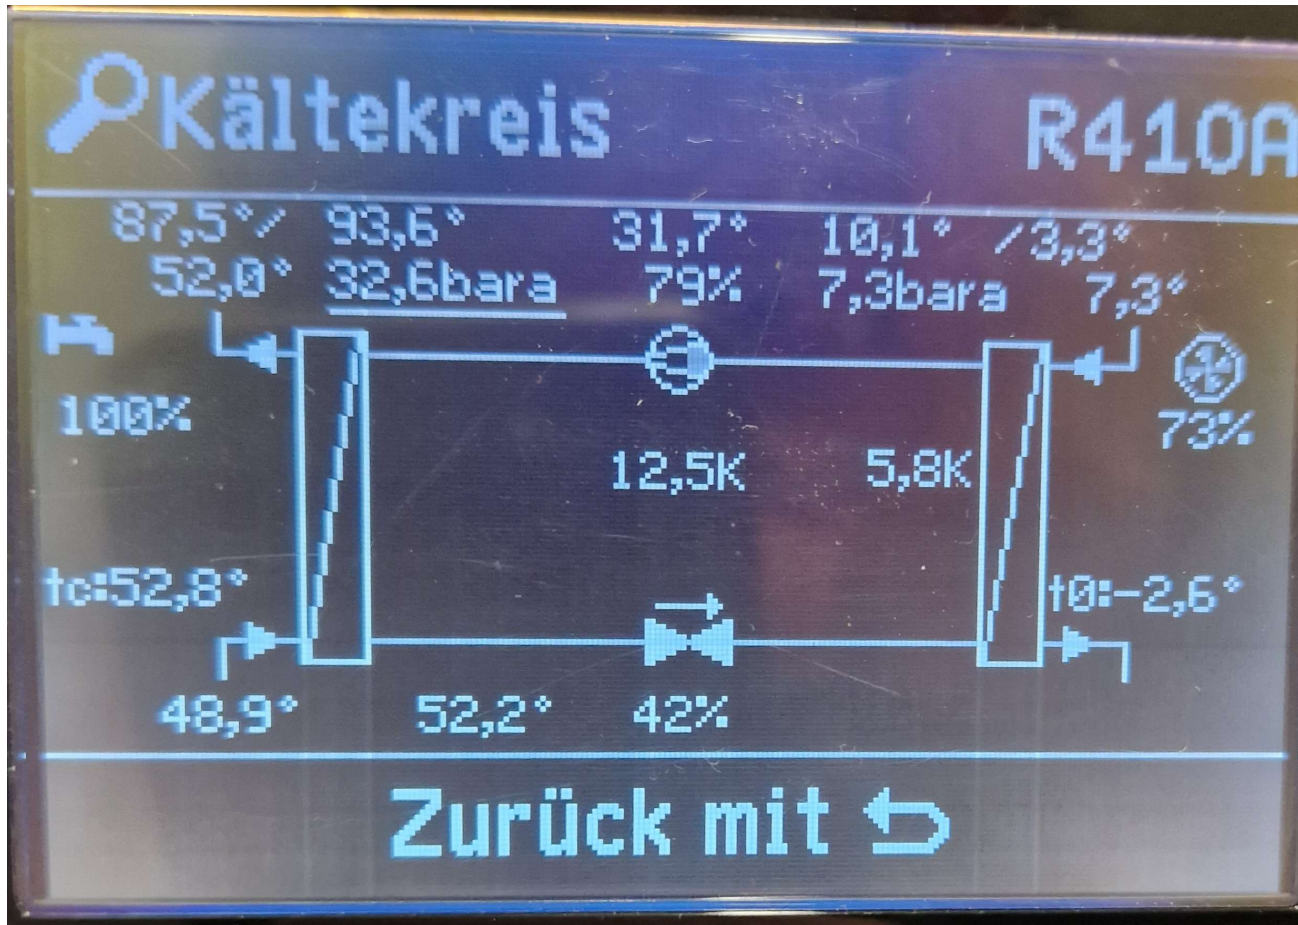

Bilder 19.13 Uhr

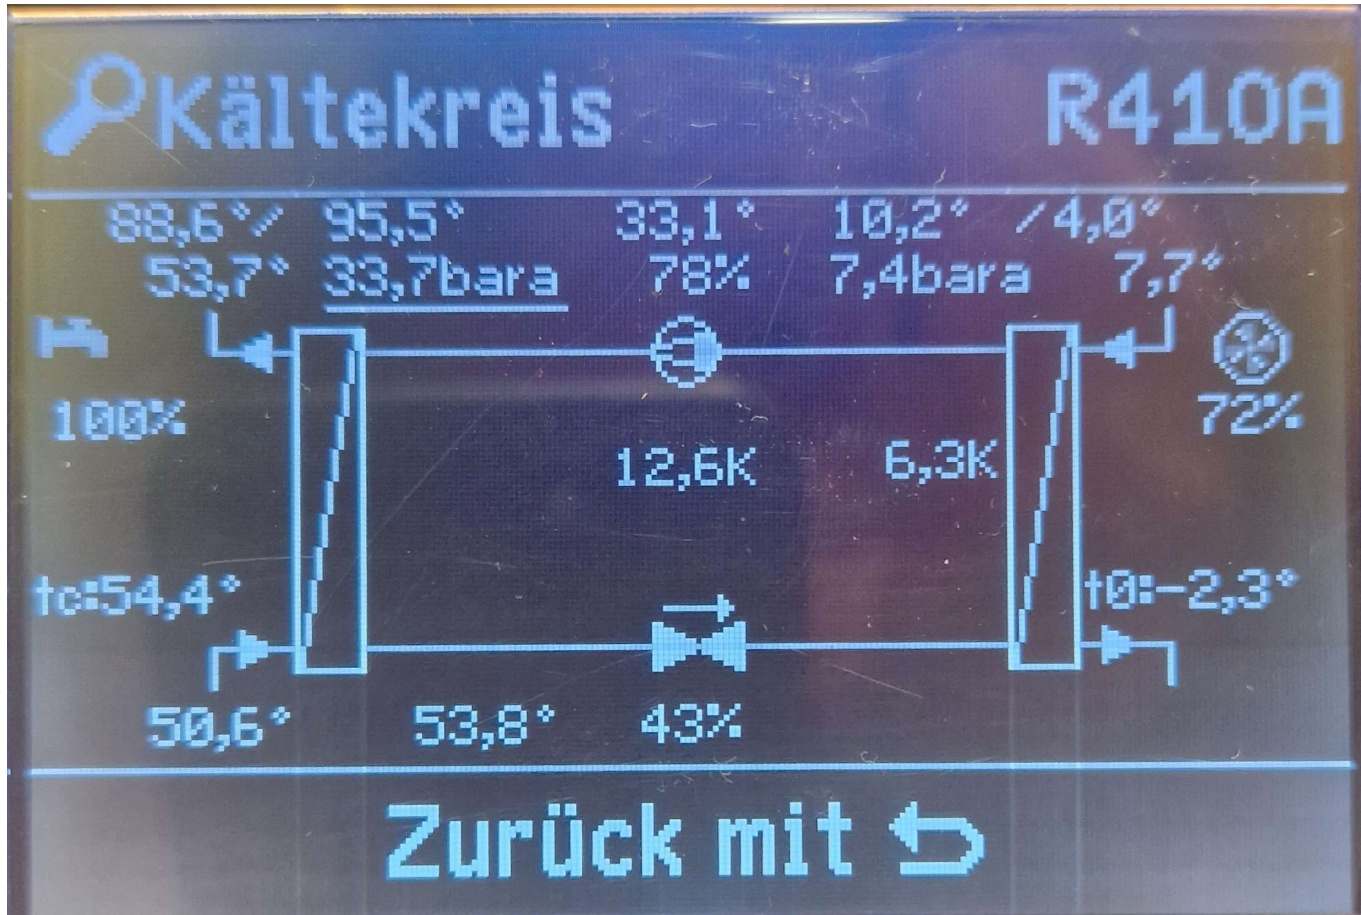

Bilder 19.22 Uhr

